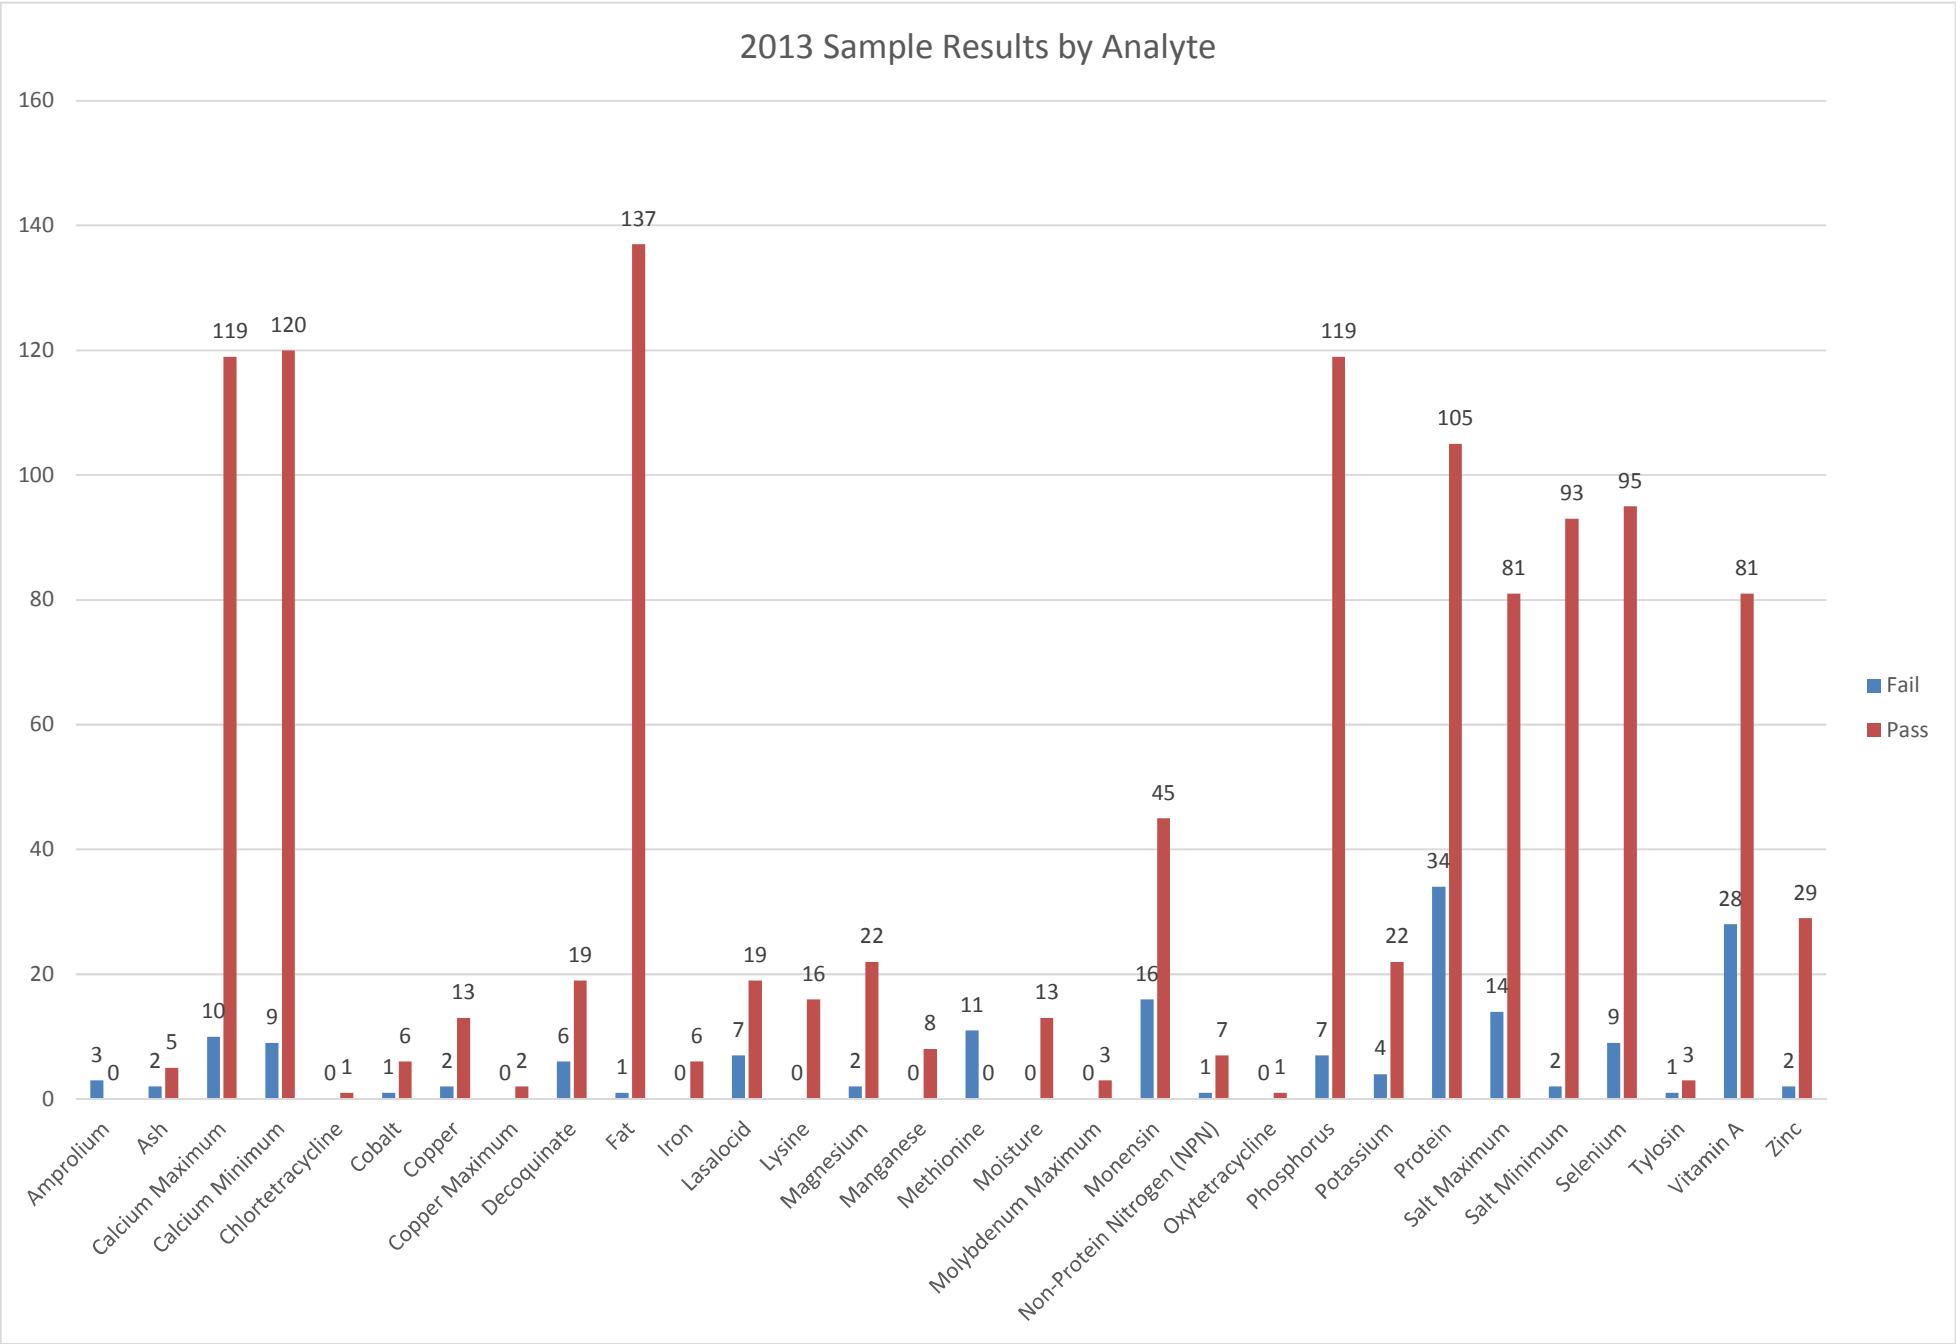
2013 Sample Results by Analyte
160
140
120
100
80
60
40
20
0
Fail
Pass
Amprolium 3 0
Ash 2 5
Calcium Maximum 10 119
Calcium Minimum 9 120
Chlortetracycline 0 1
Cobalt 1 6
Copper 2 13
Copper Maximum 0 2
Decoquinate 6 19
Fat 1 137
Iron 0 6
Lasalocid 7 19
Lysine 0 16
Magnesium 2 22
Manganese 0 8
Methionine 11 0
Moisture 0 13
Molybdenum Maximum 0 3
Monensin 16 45
Non-Protein Nitrogen (NPN) 1 7
Oxytetracycline 0 1
Phosphorus 7 119
Potassium 4 22
Protein 34 105
Salt Maximum 14 81
Salt Minimum 2 93
Selenium 9 95
Tylosin 1 3
Vitamin A 28 81
Zinc 2 29