



STATE OF WISCONSIN
Department of Agriculture,
Trade and Consumer Protection

Approval # 20170002
(Renewal for 20140002)

Bureau of Weights and Measures
Storage Tank Regulation
P.O. Box 7837
Madison, WI 53707-7837

Wisconsin ATCP 93 Material Approval

Equipment: Secondary Containment Vessels

Manufacturer: Wieser Concrete Products, Inc.
2815 Riley Rd.
Portage, WI 53901

Expiration of Approval: December 31, 2020

SCOPE OF EVALUATION

The secondary containment vessels manufactured by Wieser Concrete Products, Inc. were evaluated against the diking requirements of **s. ATCP 93.420** and the secondary containment and vehicle collision protection requirements of **ss. ATCP 93.615(5) (f) to (g)** of the Wisconsin Flammable and Combustible Liquids Code.

This evaluation summary is condensed to provide the specific installation, application, and operational parameters necessary to maintain the subject systems in compliance with the Wisconsin Administrative Code – ATCP 93.

DESCRIPTION AND USE

The secondary containment vessels are made of steel-reinforced precast concrete. Anchor bolts are provided to tie down the storage tank. To remove rainwater from the vessel, a siphon system is mounted on the side. The siphon must be manually primed each time the vessel is to be emptied. An alternative method for water removal is a 1-inch galvanized pipe through the vessel wall at the sump using a self-closing valve.

The secondary containment systems covered by this approval are sized as described in Table 1 below.

Table 1
Secondary Containment Sizes

<u>Model Number</u>	<u>Spill/Leak Capacity</u>	<u>Tank Size</u>
SL300	405 Gallons	300 Gallons/38" Diameter
SL550A	886 Gallons	550 Gallons/48" Diameter or 560 Gallons/48" Diameter
SL1000	1,317 Gallons	1,000 Gallons/48" Diameter
SL1500	1,895 Gallons	1,500 Gallons/64" Diameter
SL2000	2,500 Gallons	2,000 Gallons/64" Diameter

TESTS AND RESULTS

Structural calculations were prepared by Registered Engineer John O. Hamel of Lake Delton, Wisconsin.

A videotape of an actual collision test is on file with the department.

LIMITATIONS / CONDITIONS OF APPROVAL

- In accordance with **s. ATCP 93.420(2)(b)**, the secondary containment vessel shall have a capacity 25 percent larger than the tank it contains.
- The vessels shall be sized to provide sufficient clearance for visual inspection of the tank. No additional clearance for collision protection is required provided the tank is centered in the vessel and firmly bolted to the vessel.
- A reduced dispenser to tank setback is allowed for snowmobile, all-terrain vehicle (ATV), marine, and fleet fueling using any listed tank.
- The tank system shall be designed, installed, and maintained in accordance with the applicable sections of ATCP 93, NFPA 30 and NFPA 30A.

- An aboveground storage tank installer certified by the department in accordance with **SPS 5.84** shall supervise the installation.
- Additional vehicle collision protection, such as posts or rails in accordance with **s. ATCP 93.430** are not required provided the tank is fastened with anchor bolts in the center of the vessel; and shear valves, flexible connectors or other protective devices are installed on product and/or electrical lines to assure adequate system flexibility should the system be displaced by collision.

Unusual or heavy traffic patterns may require additional visual warning or collision protection.


This approval will be valid through December 31, 2020, unless manufacturing modifications are made to the product or a re-examination is deemed necessary by the department. The Wisconsin Material Approval Number must be provided when plans that include this product are submitted for review.

DISCLAIMER

The Department is in no way endorsing or advertising this product. This approval addresses only the specified applications for the product and does not waive any code requirement unless specified in this document.

Effective Date: June 20, 2017

Reviewed by:  6/20/17
Erik Otterson
Environmental Engineering Specialist
Storage Tank Regulation

Approved by:  Date: 6/20/17
Greg Baretta, P.E.
Section Chief
Storage Tank Regulation



Wisconsin Department of Agriculture, Trade and Consumer Protection
Bureau of Weights and Measures, Storage Tank Regulation
P.O. Box 7837
Madison, WI 53707-7837
(608) 224-4942

FOR OFFICE USE ONLY

19927

Wis. Admin. Code §ATCP 93.130

WISCONSIN MATERIAL APPROVAL APPLICATION

CR # 4899

For ATCP 93 related flammable, combustible or hazardous liquid storage systems.

INSTRUCTIONS: One application form per material approval. Type or print clearly. Make checks payable to: DATCP. Send application, fee and any required additional information (see back of form) to address above.

Submitting Party Information

Applicant Company Name: <u>WIESER CONCRETE PRODUCTS, INC</u>	Applicant Address, City, State, Zip Code: <u>2815 RILEY ROAD, PORTAGE WI 53901</u>
Contact Person and Telephone Number: <u>MARK WIESER 608-742-4464</u>	E-mail: <u>MARKW@WIESERCONCRETE.COM</u>

Manufacturer Information


Manufacturer Name (If same as applicant, write "same"): <u>SAME</u>	Manufacturer Address:
Contact Person and Telephone Number:	E-mail:

Product information

Product (e.g. Tank, Leak detection methodology, Dike liner, etc.): <u>SECONDARY CONTAINMENT VESSELS</u>	Trade Name:
--	-------------

Description and Use of Material (attach additional sheets if necessary):

SEE ATTACHED

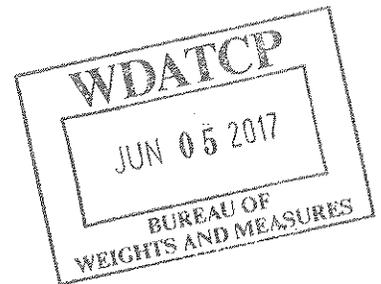

Submittal Type and Fee (check type and submit fee):

New Approval..... \$1000.00 Minor Revision ¹ At Manufacturer's Request (No extension of approval period.) \$200.00
 Renewal, With Changes... \$1000.00
 Renewal, No Changes..... \$750.00 Major Revision ² At Manufacturer's Request (New 3-year period.)..... \$1000.00
 Current Approval Number, If Any: 20140002

Wisconsin Code Sections Under Which Approval Is Requested (if known):

Determination of approval will be based on evidence which shows that the material performs in a manner which is equal, or superior, to the material, application or concept required by the code section listed above.

NATIONAL EVALUATION SERVICES APPROVALS: If the applicant has obtained approvals of the product or methodology from any national evaluation service(s) please indicate by checking the blocks below:
 ICBO BOCA NES KWA UL SwRI OTHER _____

PUBLIC RECORDS: Department files and records may be subject to public inspection and copying unless they are designated as containing trade secrets. Do you wish your documents to be so designated? YES NO

If a request is received for your filings, we will notify you so you may take any appropriate action.

I affirm that the information submitted with this application is, to my knowledge and understanding, correct.

Applicant's Signature & Title: Mark Wieser VP Date Signed: 6-1-17

Personal information that you provide may be used for purposes other than that for which it was originally collected (s.15.04(1)(m), Wis. Stats.)
An application for a Wisconsin Material Approval must include the following:

DESCRIPTION AND USE

The secondary containment vessels are made of steel-reinforced precast concrete. Anchor bolts are provided to tie down the storage tank. To remove rainwater from the vessel, a siphon system is mounted on the side. The siphon must be manually primed each time the vessel is to be emptied. An alternative method for water removal is a 1-inch galvanized pipe through the vessel wall at the sump using a self-closing valve.

The secondary containment systems covered by this approval are sized as described in Table 1 below.

Table 1
Secondary Containment Sizes

<u>Model Number</u>	<u>Spill/Leak Capacity</u>	<u>Tank Size</u>
SL300	405 Gallons	300 Gallons/38" Diameter
SL550A	886 Gallons	550 Gallons/48" Diameter or 560 Gallons/48" Diameter
SL1000	1,317 Gallons	1,000 Gallons/48" Diameter
SL1500	1,895 Gallons	1,500 Gallons/64" Diameter
SL2000	2,500 Gallons	2,000 Gallons/64" Diameter

